

# Stroom Capaciteitsrapport

PQBOX150 V4.614


Ge genereerd: 16 Mar 2026 16:30

Analyseperiode	Maximale stroom (ingesteld)	Aantal fasen
10/12/2025 16:05 -> 11/12/2025 07:20	100 A	4


## Resultaten per fase

Fase	Gem. (A)	Gem. (%)	Piek (A)	Piek (%)	Ruimte gem.	Ruimte piek	Status
L1	36.0	36%	77.3	77%	+64.0 A	+22.7 A	Let op
L2	34.6	35%	72.3	72%	+65.4 A	+27.7 A	Let op
L3	34.7	35%	72.3	72%	+65.3 A	+27.7 A	Let op
N	8.2	8%	15.1	15%	+91.8 A	+84.9 A	OK

## Bezettingsgrafiek

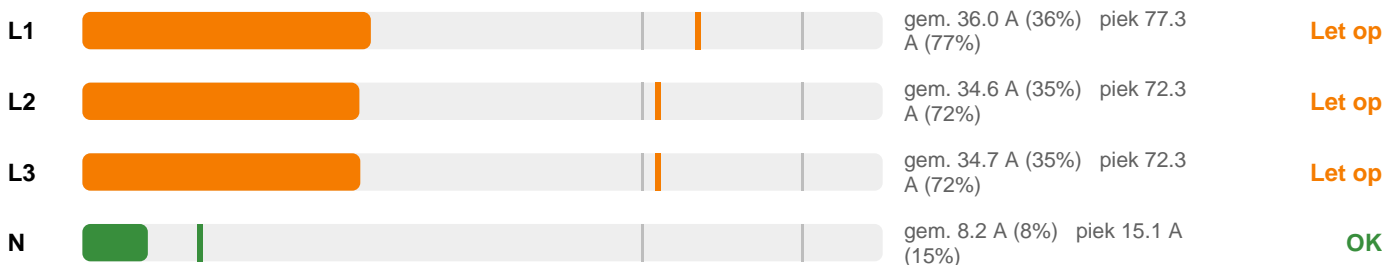

## Stroom over tijd

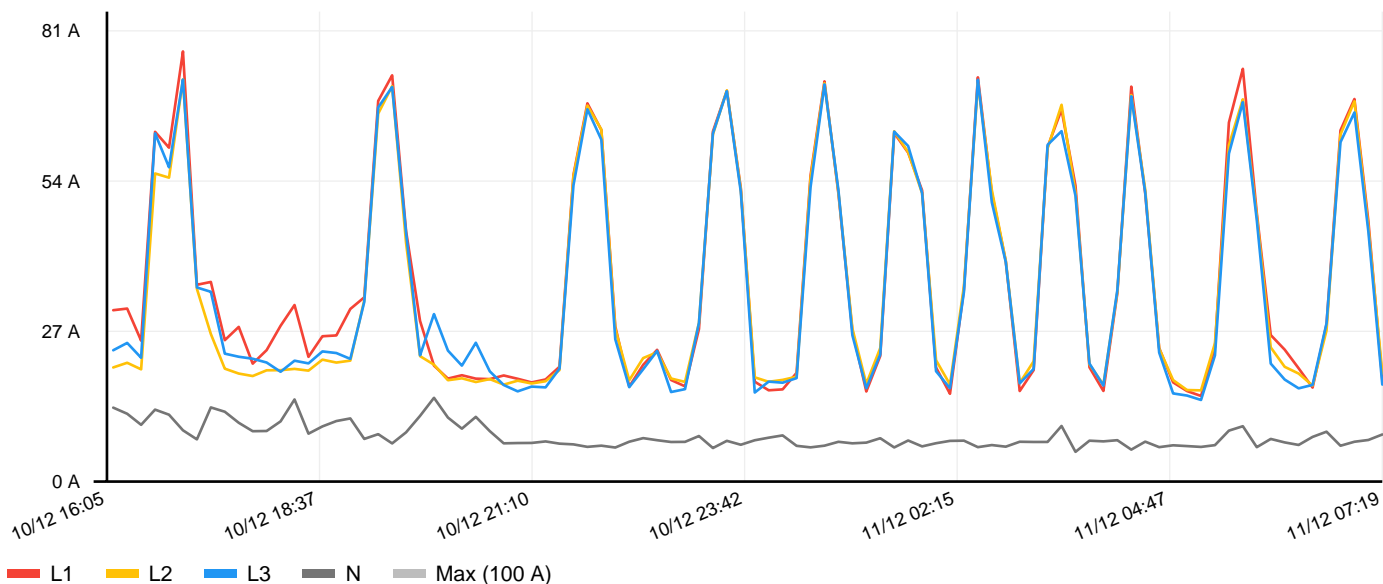

Status: ● OK (piek < 70%) ● Let op (70 - 90%) ● Kritiek (>= 90%) De piekstroom bepaalt de status.