

Stroom Capaciteitsrapport

PQBOX150 V4.614


Gegenereerd: 16 Mar 2026 16:31

Analyseperiode	Maximale stroom (ingesteld)	Aantal fasen
10/12/2025 16:05 -> 10/12/2025 21:44	100 A	4


Resultaten per fase

Fase	Gem. (A)	Gem. (%)	Piek (A)	Piek (%)	Ruimte gem.	Ruimte piek	Status
L1	32.8	33%	77.3	77%	+67.2 A	+22.7 A	Let op
L2	29.0	29%	72.3	72%	+71.0 A	+27.7 A	Let op
L3	30.9	31%	72.3	72%	+69.1 A	+27.7 A	Let op
N	10.0	10%	15.1	15%	+90.0 A	+84.9 A	OK

Bezettingsgrafiek

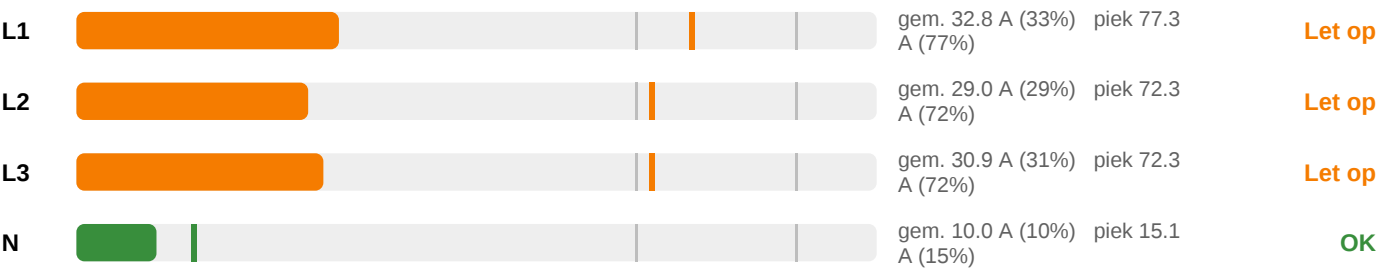

Stroom over tijd

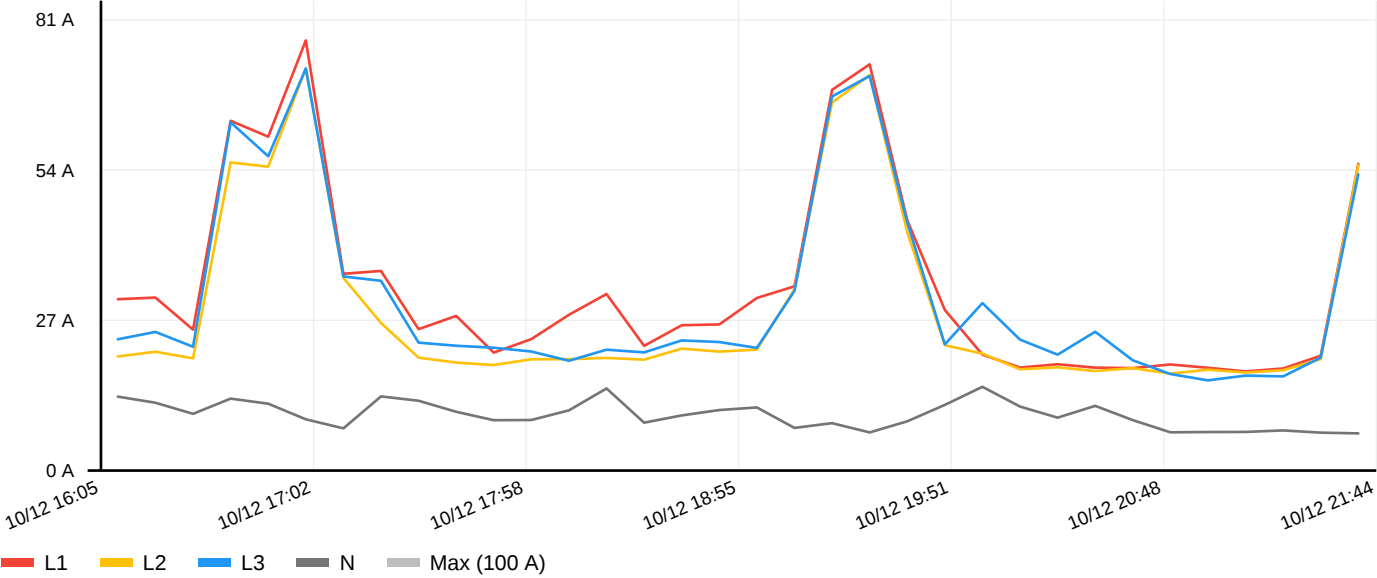

Status:	OK (piek < 70%)	Let op (70 - 90%)	Kritiek (>= 90%)	De piekstroom bepaalt de status.
---------	-----------------	-------------------	------------------	----------------------------------