

Opname-rapport

PQBOX150 V4.614


Gegenereerd: 16 Mar 2026 16:01

Periode	Duur
10/12/2025 17:35 - 11/12/2025 07:20	0d 13h 44m


Momentopname - 10/12/2025 17:40

Meting	L1	L2	L3	N
I (A)	27.80 A	19.41 A	22.43 A	10.56 A
THD I (%)	20.00 %	23.49 %	23.77 %	
cos	0.999 (ind)	0.995 (ind)	0.999 (ind)	


Stroom (A) - 10-min gemiddelden

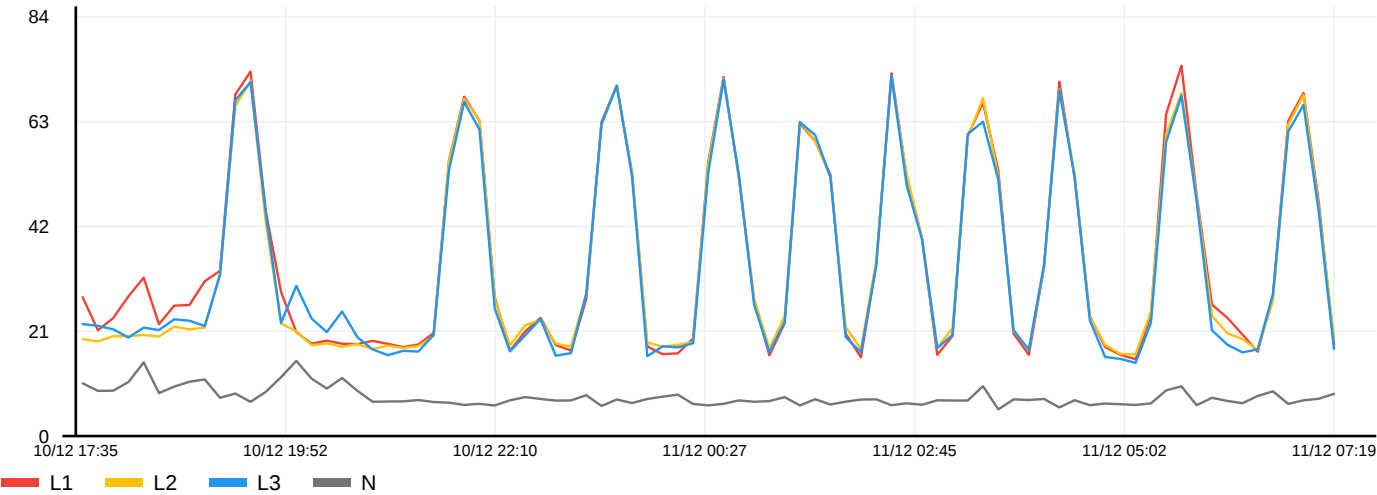

Totale harmonische vervorming stroom THD (%)

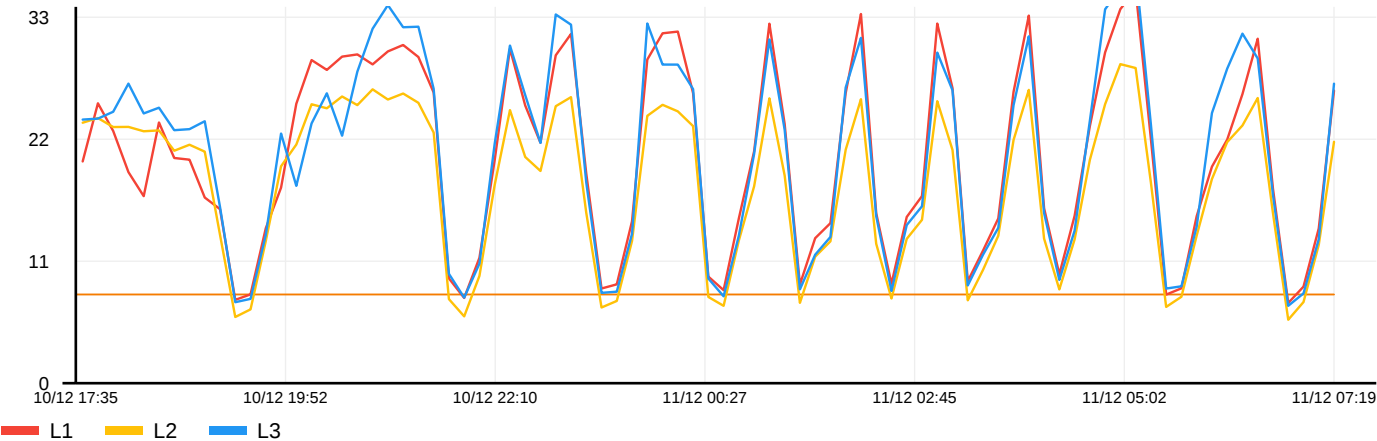

|cos| vermogensfactor

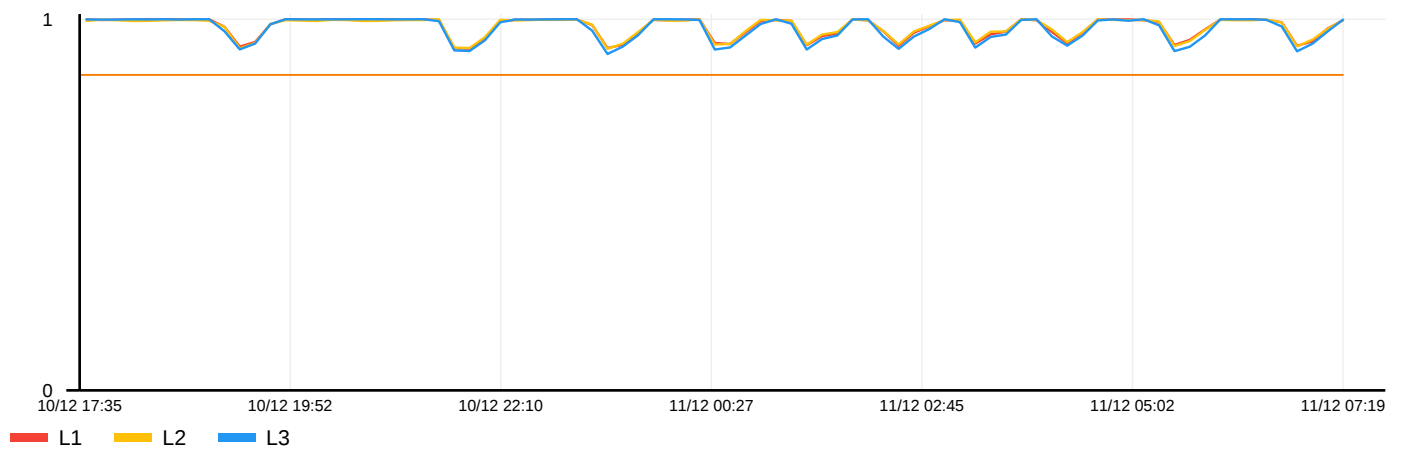

Harmonisch spectrum momentopname (A)

Order	L1 (A)	L2 (A)	L3 (A)	Order	L1 (A)	L2 (A)	L3 (A)
h2	1.4480	1.5722	2.2825	h14	0.1342	0.0609	0.0365
h3	4.3632	3.2138	3.6021	h15	0.1915	0.1305	0.1397
h4	2.8507	2.4274	2.9459	h16	0.1319	0.1686	0.0996
h5	0.5365	0.9371	0.6586	h17	0.0283	0.1341	0.0220
h6	0.6050	0.2715	0.4817	h18	0.0804	0.1620	0.1325
h7	0.7851	0.6703	0.5341	h19	0.1345	0.2141	0.0731
h8	0.1081	0.3182	0.1974	h20	0.0702	0.0668	0.0278
h9	0.3063	0.5299	0.5125	h21	0.1479	0.0401	0.1028
h10	0.2366	0.3444	0.2579	h22	0.0834	0.0355	0.1462
h11	0.1210	0.1752	0.0345	h23	0.0347	0.0412	0.0317
h12	0.1468	0.0372	0.2172	h24	0.0684	0.0815	0.1233
h13	0.1704	0.0647	0.2925	h25	0.0573	0.0409	0.1154